

Super Efficient Super Hot Drop-In



Project: _____

Item: _____

Quantity: _____

Date: _____

Drop-in Models	Wells
<input type="checkbox"/> DI-EF-1D	1
<input type="checkbox"/> DI-EF-2D	2
<input type="checkbox"/> DI-EF-3D	3
<input type="checkbox"/> DI-EF-4D	4
<input type="checkbox"/> DI-EF-5D	5
<input type="checkbox"/> DI-EF-6D	6

Standard Features


- ✓ Solid state digital controls
- ✓ Full sealing gasket
- ✓ 500 watts (at 208V)
- ✓ Single power source

Optional Features (specify)

- Custom sign/logo (specify _____)
- Small pan adapter bars
- Adapter panel
- Skirt mounted control adapter
- Other voltage, phase, cycle (specify _____)

- ▶ Versatile, use wet or dry
- ▶ Fully insulated, for use in any counter
- ▶ 1 to 6 pan units provide for full menus
- ▶ Manifold drains make installation easy
- ▶ Labor saving easy to clean design

Super Efficient Super Hot Drop-In

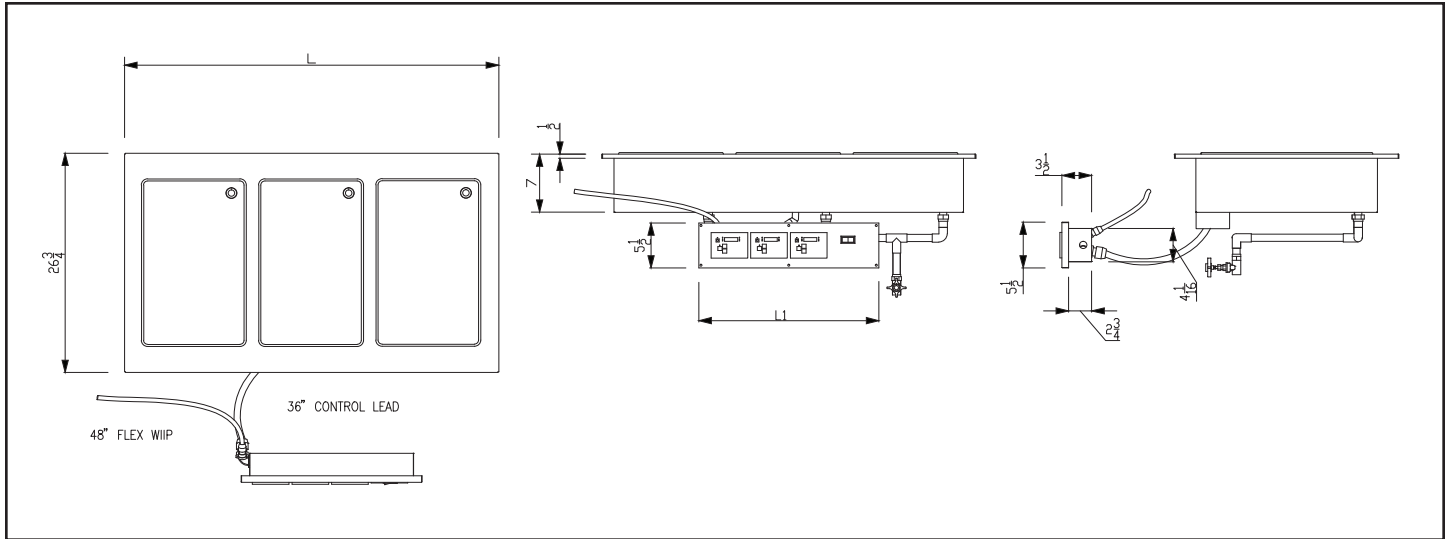

Model #	Pans	L	L1	Cut-out size	208V, 1 phase		120V, 1 phase		240V, 1 phase	
					Watts	Amps	Watts	Amps	Watts	Amps
DI-EF-1	1	16 1/2"	7 1/4"	22 5/8" x 14 1/4"	500	2.4	661	5.5	661	2.8
DI-EF-2	2	30 1/2"	12"	22 5/8" x 28 1/4"	1000	4.8	1322	11	1322	5.5
DI-EF-3	3	44 1/2"	16 3/4"	22 5/8" x 42 1/4"	1500	7.2	1983	16.5	1983	8.3
DI-EF-4	4	58 1/2"	21 1/2"	22 5/8" x 56 1/4"	2000	9.6	2644	22	2644	11.0
DI-EF-5	5	72 1/2"	26 1/4"	22 5/8" x 70 1/4"	2500	12.0	3305	27.5	3305	13.8
DI-EF-6	6	86 1/2"	31"	22 5/8" x 84 1/4"	3000	14.4	3966	33.1	3966	16.5

General Specifications

Top perimeter frame to be constructed of 14 gauge stainless steel, welded, ground and polished with a thermal break provided between the top and heated sections

Interior pan to be 18 gauge stainless steel, fully welded, ground and polished. To be fully insulated with fiberglass insulation.

The exterior jacket to be constructed of 18 gauge galvanized steel.

Each compartment to have 500 watt heat source with solid state digital controls.

All switches and controls to be fully accessible. Units to be UL listed and shall bear the UL Sanitation seals.

Approval/Submittal (signature required)

Model # _____

Flange Edge Detail:

Turned (T) _____ Hugged (H) _____

(T) = 1/2" 90° turn down
(H) = 14 gauge thickness

Voltage _____

Adherence to LTI installation instructions is required.

Failure to do so may void the warranty.

Signature _____

Date _____

Control Panel cut-out size
11" X 4 1/4"
15 3/4" X 4 1/4"
20 1/2" X 4 1/4"
25 1/4" X 4 1/4"
30" X 4 1/4"
34 3/4" X 4 1/4"

We reserve the right to change specifications and product design without notice. Such revisions do not entitle the buyer to corresponding changes, improvements, additions or replacement for previously purchased equipment.

All equipment to be built in accordance with the Underwriters Laboratories, Inc. and the National Sanitation Foundation, Inc. standards and shall bear the Underwriters Laboratories, Inc listing label for safety and the Underwriters Laboratories classification label for sanitation.

REV 7/30/18



LTI, Inc.
P.O. Box 795
Jonesboro, GA 30237

T 770 478 8803
F 770 471 3715
W lowtempind.com



U.L. Sanitation Classified to NSF Standards